





LEGEND

EXISTING WALL DUPLEX POWER RECEPTACLE (NO CHANGE)	NEW DUPLEX POWER RECEPTACLE ON PLUGMOLD #2000 RACEWAY INSULATED IN TRADING DESK CABLE SPACE
EXISTING OR WALL OR FLOOR DUPLEX POWER RECEPTACLE TO BE REMOVED AND CAPPED. SEE DWG 105R-4 FOR LOCATION	NEW DUPLEX POWER RECEPTACLE ON PLUGMOLD #2000 RACEWAY INSULATED IN TRADING DESK CABLE SPACE
EXISTING OR WALL OR FLOOR MOUNTED TELEPHONE OUTLET TO BE REMOVED AND CAPPED. SEE DWG 105R-4 FOR LOCATION	NEW DUPLEX CONVENIENCE RECEPTACLE SURFACE MOUNTED IN TRADING DESK CABLE SPACE
NEW DUPLEX WALL MOUNTED POWER RECEPTACLE SET @ 1'-0" AFF. UNLESS NOTED OTHERWISE ON PLAN. NEMA, 5-15R	SPECIAL PURPOSE POWER RECEPTACLE SEE SCHEDULE THIS SHEET
NEW DUPLEX POWER RECEPTACLE ON PLUGMOLD #2000 RACEWAY INSULATED IN TRADING DESK CABLE SPACE	MODULAR TELEPHONE TURRET BUILT INTO TRADING DESK I.P.C. TRADNET SERIES III MODULES. SEE DWG 105R-9 FOR LOCATION
NEW DUPLEX CONVENIENCE RECEPTACLE SURFACE MOUNTED IN TRADING DESK CABLE SPACE	TELEPHONE JACK MOUNTED TO UPRIDE OF TRADING DESK TOP. FURNISHED & INSTALLED BY I.P.C. SEE DWG 105R-9 FOR LOCATION
SPECIAL PURPOSE POWER RECEPTACLE SEE SCHEDULE THIS SHEET	MODULAR TELEPHONE TURRET BUILT INTO TRADING DESK I.P.C. SERIES II MODULES
MODULAR TELEPHONE TURRET BUILT INTO TRADING DESK I.P.C. TRADNET SERIES III MODULES. SEE DWG 105R-9 FOR LOCATION	SIGNAL OUTLET SEE SCHEDULE THIS SHEET
TELEPHONE JACK MOUNTED TO UPRIDE OF TRADING DESK TOP. FURNISHED & INSTALLED BY I.P.C. SEE DWG 105R-9 FOR LOCATION	CLOCK HANGER RECEPTACLE LEVITON #C5B OR EQUAL SEE DWG 105R-8
MODULAR TELEPHONE TURRET BUILT INTO TRADING DESK I.P.C. SERIES II MODULES	QUADRUPLUX RECEPTACLE 15A SURFACE MOUNTED TO CONCRETE SLAB BELOW RAISED FLOOR
SIGNAL OUTLET SEE SCHEDULE THIS SHEET	QUADRUPLUX RECEPTACLE 15A INSTALLED IN RECESSED FLIP-TOP RECEPTACLE IN RAISED ACCESS FLOOR PANEL
CLOCK HANGER RECEPTACLE LEVITON #C5B OR EQUAL SEE DWG 105R-8	INDICATES GROMMET IN RAISED ACCESS FL. FOR L.V. TELEPHONE & DATA CABLES
QUADRUPLUX RECEPTACLE 15A SURFACE MOUNTED TO CONCRETE SLAB BELOW RAISED FLOOR	NEW WALL TELEPHONE OUTLET INSTALL @ 4'-0" A.F.F.
QUADRUPLUX RECEPTACLE 15A INSTALLED IN RECESSED FLIP-TOP RECEPTACLE IN RAISED ACCESS FLOOR PANEL	LOW VOLTAGE CBT MONITOR ELECTRONIC SWITCH, IN TECH INC. MODEL 915A, SUPPLIED BY C.F.S.C. SEE DWG 105R-9 FOR LOCATION
INDICATES GROMMET IN RAISED ACCESS FL. FOR L.V. TELEPHONE & DATA CABLES	LOW VOLTAGE CBT MONITOR A/D SWITCH SUPPLIED BY C.F.S.C. SEE DWG 105R-9 FOR LOCATION
NEW WALL TELEPHONE OUTLET INSTALL @ 4'-0" A.F.F.	NEW DUPLEX POWER OUTLET FOR CBT MONITORS, SURFACE MOUNTED IN TRADING DESK WIREWAY. KEEP CBT RECEPT. ON INDIVIDUAL CIRCUITS
LOW VOLTAGE CBT MONITOR ELECTRONIC SWITCH, IN TECH INC. MODEL 915A, SUPPLIED BY C.F.S.C. SEE DWG 105R-9 FOR LOCATION	PLUGMOLD #2000 LENGTH & RECEPTACLE SPACING AS SHOWN ON PLAN
LOW VOLTAGE CBT MONITOR A/D SWITCH SUPPLIED BY C.F.S.C. SEE DWG 105R-9 FOR LOCATION	
NEW DUPLEX POWER OUTLET FOR CBT MONITORS, SURFACE MOUNTED IN TRADING DESK WIREWAY. KEEP CBT RECEPT. ON INDIVIDUAL CIRCUITS	
PLUGMOLD #2000 LENGTH & RECEPTACLE SPACING AS SHOWN ON PLAN	

JUSTIN PC ARCHITECTS
205 LEXINGTON AVE
NEW YORK, NY 10016
TEL (212) 689 8800

JOHN C. WESTRIK & ASSOCIATES
CONSULTING ENGINEERS
2110 MAPLE AVE. SOUTH PLAINFIELD, N.J. 07080
908-561-4170

DATE	ISSUED TO	PR	TR
4/10/92	POST AUTHORITY FOR APPROVAL	12	-
4/15/92	C.F.S.C.	2	-
5/1/92	C.F.S.C. FOR BIDDING	4	-
5/1/92	C.F.S.C.	-	5
6-10-92	POST AUTHORITY FOR APPROVAL	18	-
6-10-92	BAUER/DONAHUE & SONS	1	-
7-11-92	C.D.S. MISTEL	-	1
8-26-92	POST AUTHORITY FOR APPROVAL	12	-

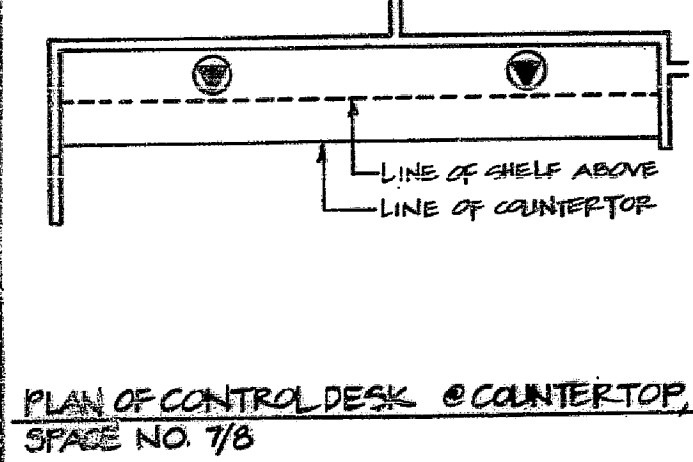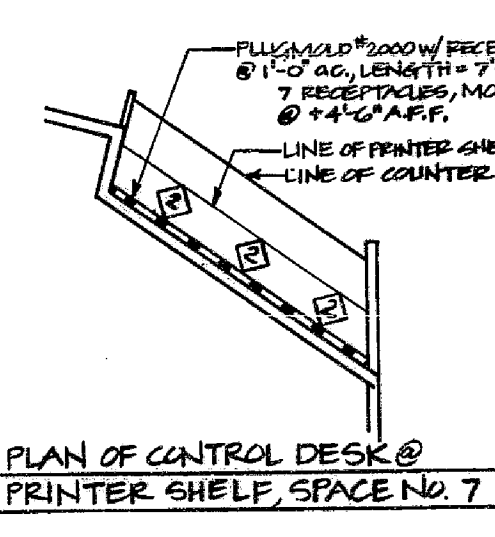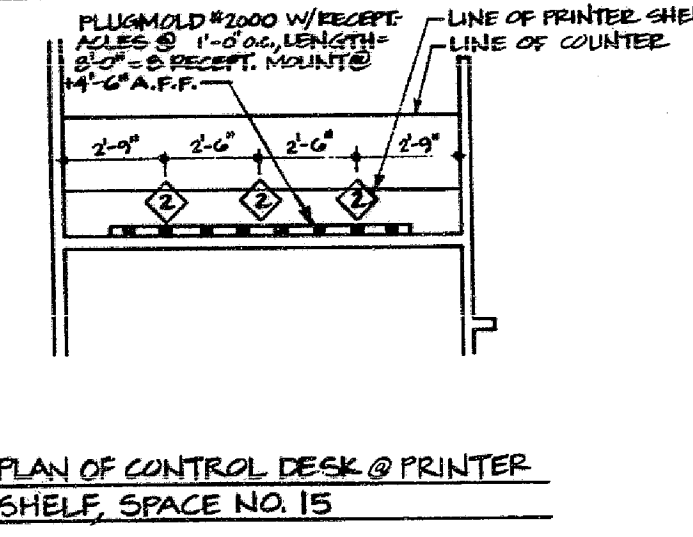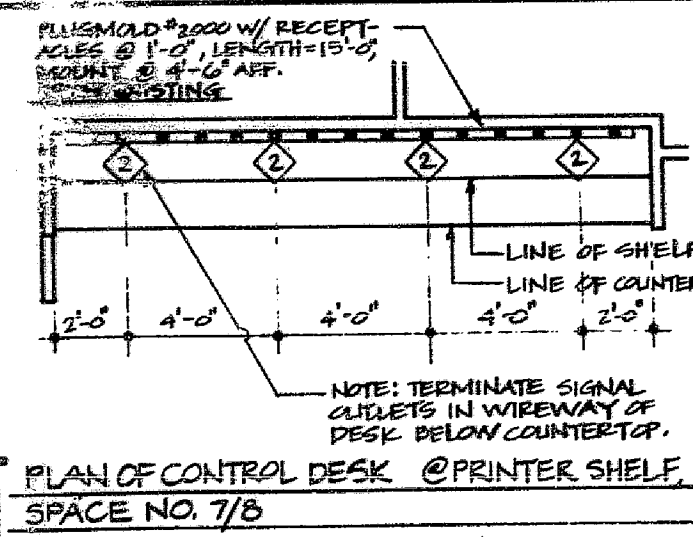

SCHEDULE OF SIGNAL OUTLETS

SYMBOL	DESCRIPTION	REMARKS
◇	TRANS-LUX NEWS JET	SPACE NO. 7, 8, SEE DRAWING 105R-8 FOR LOCATION. MOUNT HORIZ. PROVIDE PLATE W/ 1/2" Ø FOR CABLE
◇	PRINTERS	

SCHEDULE OF SPECIAL PURPOSE ELECTRIC RECEPTACLES


SYMBOL	VOLTS	AMPS	PHASE	DESCRIPTION	REMARKS
⊙	120	15A	1	TRANS-LUX BOARD RECESSED CLOCK RECEPTACLE NEMA 5-15R STEEL MOUNT SLAB U/GROUND, LEVITON C5B	LOCATED ON WEST WALL-SPACE NO. 8 & EAST WALL-SPACE NO. 7. SEE DWG 105R-8 FOR LOCATION. SET HORIZONTAL
⊙	120	20A	1	RELOCATED ELECTRONIC EQUIPMENT RACKS - SPANION ELECTRONICS	QUADRUPLUX RECEPTACLE SHALL BE WIRED AS (3) 20A SEPARATE CIRCUITS SURFACE MOUNTED ON SLAB BELOW RAISED FLOOR

NOTES

1. SEE ELECTRICAL ENGINEERING DWG 105R-E-7 FOR LOCATION OF SMOKE DETECTORS BELOW RAISED FLOOR.

NOTE: ELECTRICAL CONTRACTOR SHALL INSTALL 4" Ø DIAMETER WIRING GROMMETS IN RAISED ACCESS FLOOR AS SHOWN ON DWG NO. 105R-5. COORDINATE WITH CABINET CONTRACTOR. GROMMET SHALL BE FURNISHED BY RAISED FLOOR CONTRACTOR.

LEGEND CONTINUED

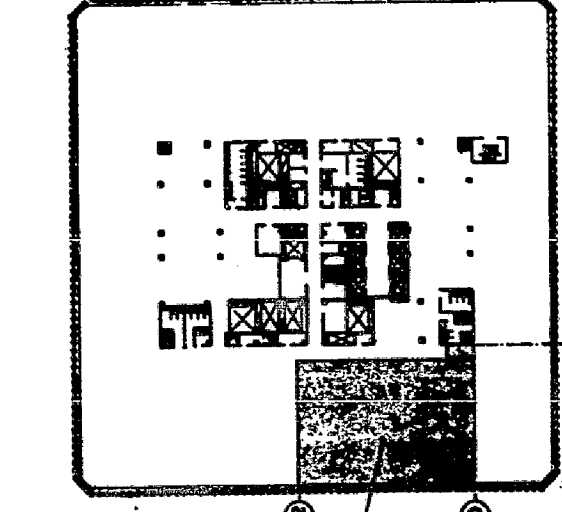

NOTE:

THIS DRAWING SHALL BE USED FOR LOCATION OF ELECTRICAL TELEPHONE RECEPTACLES ONLY. SEE ELECTRICAL ENGINEERING DWG FOR ALL CIRCUITING, CONDUITS, PANEL BOARD CONNECTIONS & ELECTRIC SPECIFICATIONS.

V.A.A. 88.
W-92041



NO	DATE	REVISION	BY
1	6-8-92	REVISED LAYOUT SPACE NO. 5, 6 & 12 PER POST AUTHORITY COMMENTS DATED 5-18-92	

CANTOR, FITZGERALD SECURITIES CORP.
105th FLOOR
ONE WORLD TRADE CENTER, NEW YORK, N.Y.

PROPOSED ALTERATION TO C.S.B. TRADING ROOM POWER & TELEPHONE PLAN

PROJECT NO. 72
SCALE 1/8" = 1'-0"
DRAWN BY TL
CHECKED BY JCP
DATE 4-27-92
DRAWING NO. 105R-8